


Section A-A

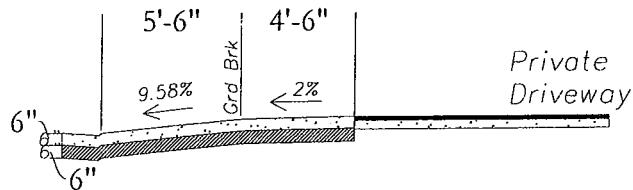

Notes:

1. Dark gray truncated dome tiles (Typ., both ramps). Exact location, size (3'x4') and placement per City of San Marcos Public Works Inspector.
2. Transition from 6" height curb to flush (0" height) curb (Typ., both curb returns).
3. No concrete shall be placed until forms and subgrade are approved by Public Works Inspector.
4. Concrete shall be 560-C-3250.
5. See Urban Street Design Criteria handout for driveway width and location parameters.
6. See San Diego Area Regional Standard Drawings G-2 and G-10 for curb and joint details.
7. The structural section shown is a minimum. Actual structural section to be recommended by Geotechnical Engineer.
8. All obstructions (i.e. over head poles, fire hydrants, etc.) shall be located a minimum of 3 feet from full curb face point.
9. 20' radius to be met on all new installations where 20' radius cannot be met size or radius to be determined by inspector.
10. Included is drawing of 3D 0" curb face.

Revised By	Date	08/12/13	CITY OF SAN MARCOS	Scale	N.T.S.
Approved By	ME	Date	08/12/13	Ref.	_____
Checked By	IME	Date	08/12/13	Tracing No.	_____
Drawn By	ALS	Date	08/12/13		